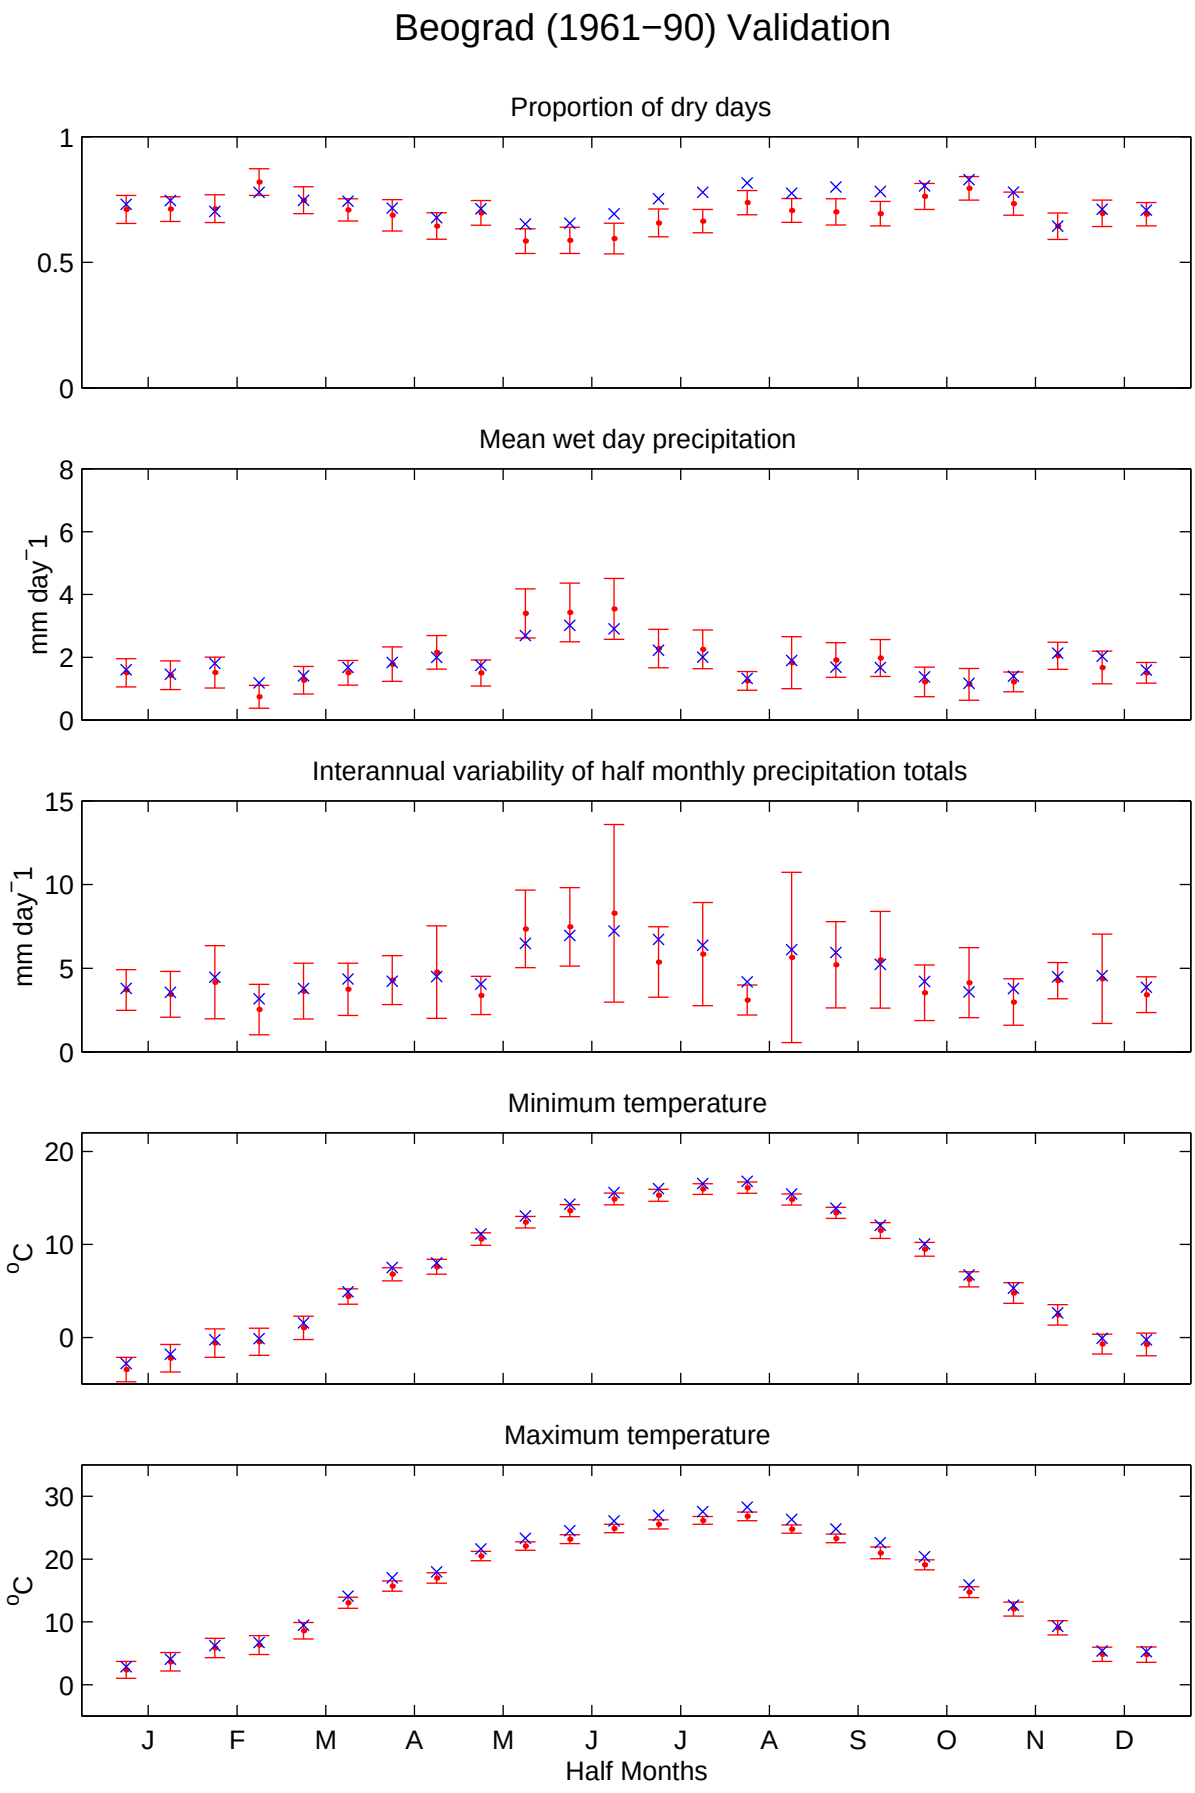
Beograd (1961−90) Validation
Proportion of dry days
1
0.5
0
Mean wet day precipitation
mm day¯1
8
6
4
2
0
Interannual variability of half monthly precipitation totals
mm day¯1
15
10
5
0
Minimum temperature
°C
20
10
0
Maximum temperature
°C
30
20
10
0
J
F
M
A
M
J
J
A
S
O
N
D
Half Months